

How Much Water Does Your Evaporative Cooling System Need?



Figure 1. A typical broiler house with an evaporative cooling system and tunnel exhaust fans. The exhaust fans are visible at the far left, while the evaporative pads are in the foreground. This particular system has two pumps on either end of the pads supplying water toward the center.

Mitigating heat stress in poultry production is a challenge. Tunnel ventilation with evaporative cooling has been used for many years to improve thermal comfort and production efficiency. Increasing ventilation rate (cfm) generally increases air speed (ft/min) and the “wind chill effect,” which has been shown to improve performance in broilers, broiler breeders, and layers. As ventilation rate increases, so does the amount of evaporative pad required and the quantity of water used for evaporative cooling (EC). As water is evaporated and bled off, water must be replenished into the system to “make up” the water consumed. The typical water supply design is based on make-up water needs plus bird consumption. Significant drought conditions have occurred in broiler-producing regions of the U.S. in recent years, and, as a result, availability and cost of water are an increasing concern for broiler producers.

EC pad systems are sized to accommodate the total building ventilation rate (cfm) while maintaining appropriate air speeds entering the pads and minimizing increases in static pressure. Typical design velocity for the air entering pads is usually around 350 ft/min, but actual velocity at the pads may range from 150 to 600 ft/min or

more depending on length of pad, ventilation capacity, and where the measurement is taken along the pad length. The length of pad installed on each side of the house is affected by house width (cross-sectional area) as well as desired house wind speed. As house width increases from 40 feet to 60-plus feet, more ventilation capacity and more pads are required to maintain 350 ft/min across the pad. The increased pad evaporates more water and requires more make-up water. For Meridian, Mississippi, a 40-foot-wide house with 700 fpm windspeed will need 11.2 gpm of make-up water to offset evaporative loss, whereas a 60-foot-wide house would use 16.8 gpm; a 50 percent increase.

Climate and weather patterns vary significantly over the geographic range where commercial poultry houses are located and result in varying make-up water needs for the EC systems. A “one size fits all” recommendation for make-up water needs may result in improperly sized water supply piping, which can lead to insufficient water supply during periods of increased demand. The goal of this publication is to provide information on how much peak evaporative make-up water is needed for typical 6-inch pad configurations.

Design or extreme temperatures, rather than average temperatures, are used to determine the amount of cooling required for a poultry house. Design temperatures are classified as 2 percent, 1 percent, and 0.4 percent, which refers to the number of hours that exceed those temperatures in a year. For example, the most extreme category (0.4 percent) for Meridian, Mississippi, is 96.8°F, which means that temperatures exceeding 96.8°F will occur for only 35 hours each year ($8,760 \text{ hours/year} \times 0.004 = 35 \text{ hours}$). Extreme temperature contour data (0.4 percent) for the continental U.S. is shown in **Figure 2**; note that extreme temperatures for much of the “broiler belt” are well below 100°F.

Figure 3 represents the peak evaporative make-up water needs expected for a 6-inch pad system operating continuously in the hottest of weather design conditions. Make-up water requirements are presented as flow rate (gpm) of water per 100,000 cfm of airflow during tunnel ventilation. Values from the maps can be scaled up or down with ventilation rate to predict changes

in consumption rates with changes in system size or operation. The examples below show make-up water needs for houses of varying width (40, 50, and 60 feet) and at different geographic locations. As the houses get wider, the average desired windspeed (700 fpm for our example) must be maintained over a larger cross-sectional area. This leads to more required ventilation capacity (cfms) that requires more make-up water (gpm). Due to a lower humidity climate, our example houses below would evaporate 30 percent more water in Livingston, California, than Meridian, Mississippi (14.6 versus 11.2 gpm, respectively).

The make-up water rates in Figure 3 and the examples below do not include continuous bleed-off that is recommended to flush the buildup of minerals and other contaminants in the EC system. If you have a program or your system is set to continuously bleed off, you should add that flow rate to the evaporative rates to obtain your total system make-up needs.

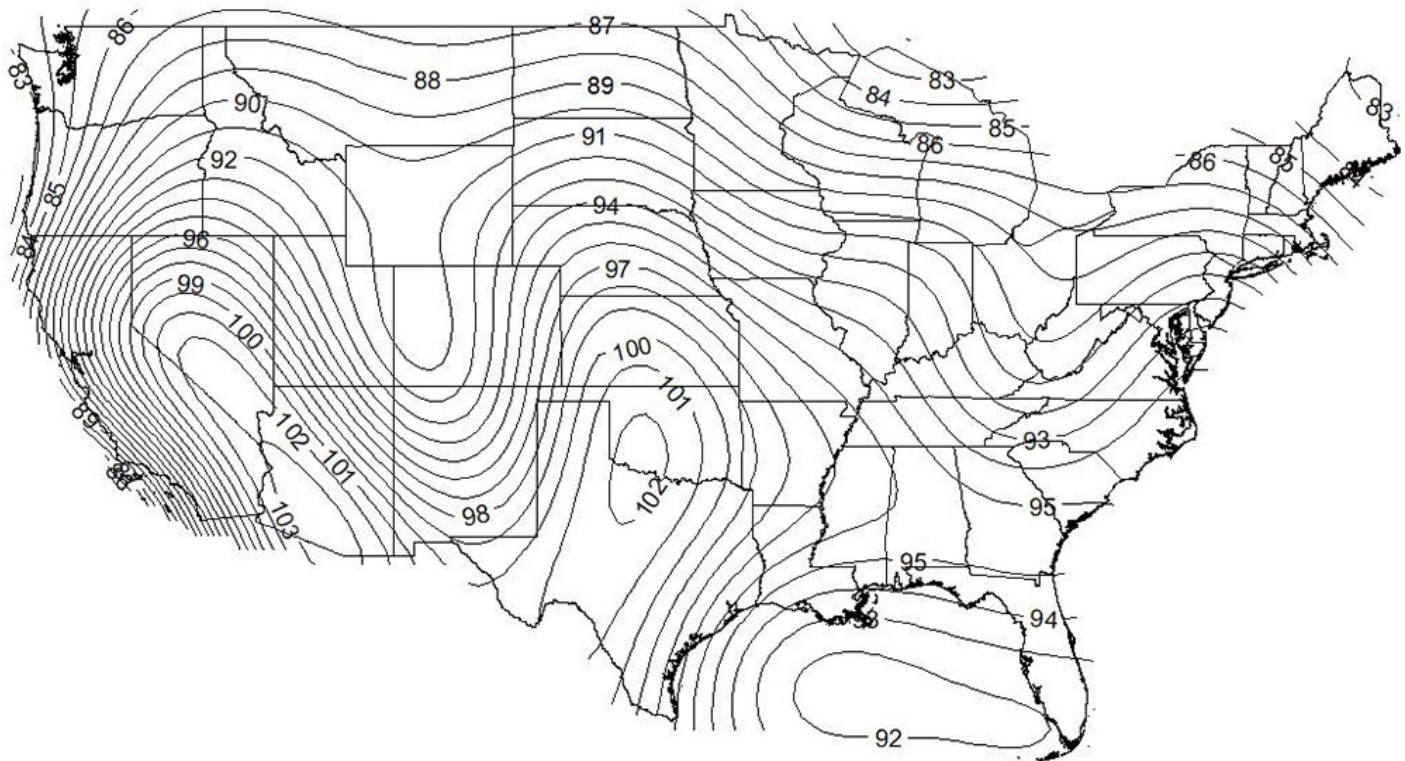


Figure 2. Dry-bulb temperatures used to calculate make-up water requirements. This map shows the most extreme warm weather ASHRAE design conditions; dry-bulb temperatures are at or above the values shown here for only 35 hours during a typical year.

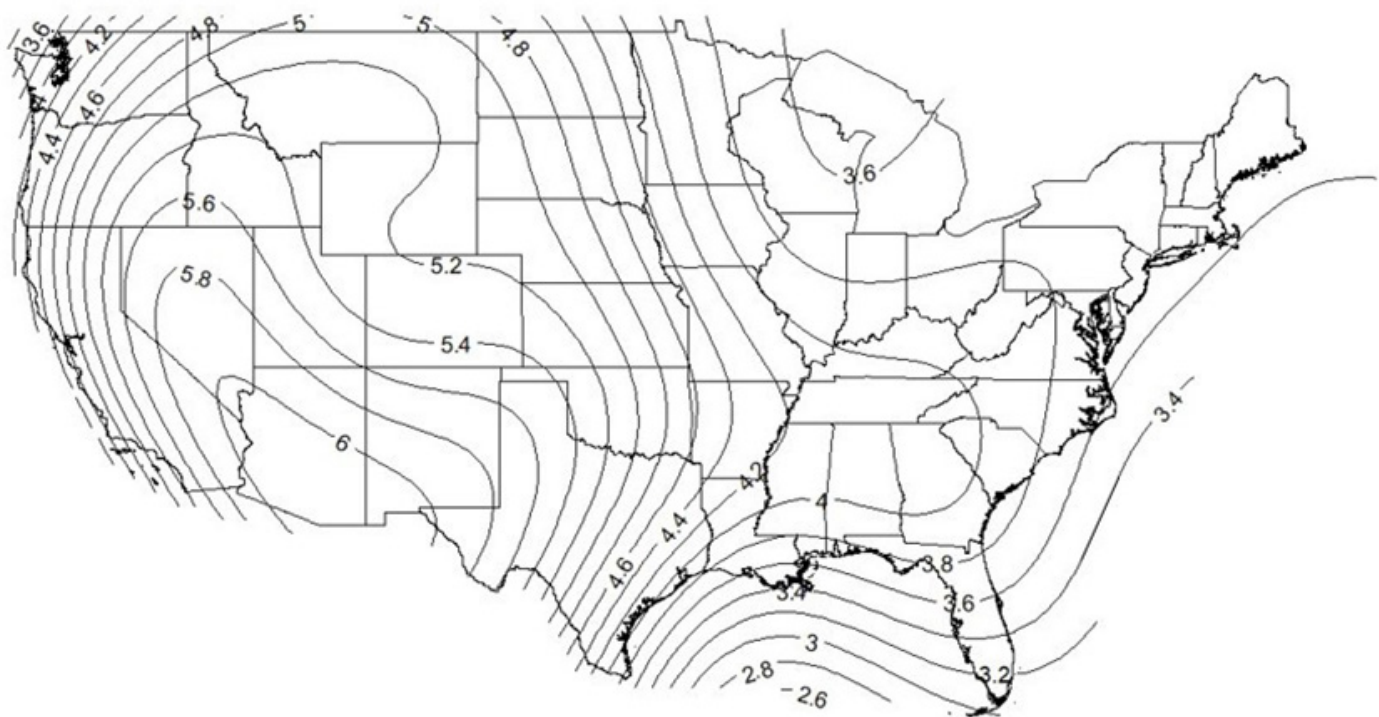


Figure 3. Amount of water evaporated (gpm per 100,000 cfm of air flow) from a 6-inch pad assuming 75 percent saturation efficiency.

Note: If your farm is located between two of the contour lines, round up to the higher of the two contour lines. In the examples below, Laurel, DE, falls between the 3.6 gpm contour line and the 3.8, so it is best to be on the safe side and round up to 3.8.

Example calculations using Figure 3

make-up water (gpm) = [(tunnel ventilation capacity (cfm) / (100,000 cfm)] × value from Figure 3 nearest your location (gpm)

ventilation capacity (cfm) = house width (ft) × [(peak height (ft) + sidewall height (ft)) / 2] × house windspeed (fpm)

Location	House Specifications	Make-up Water Needed
Meridian, MS	1) House Width: 40 ft 2) House Windspeed: 700 fpm 3) Ventilation Capacity: 280,000 cfm	(280,000 cfm) / (100,000 cfm) = 2.8 2.8 × 4 gpm* = 11.2 gpm
Meridian, MS	1) House Width: 50 ft 2) House Windspeed: 700 fpm 3) Ventilation Capacity: 350,000 cfm	(350,000 cfm) / (100,000 cfm) = 3.5 3.5 × 4 gpm* = 14 gpm
Meridian, MS	1) House Width: 60 ft 2) House Windspeed: 700 fpm 3) Ventilation Capacity: 420,000 cfm	(420,000 cfm) / (100,000 cfm) = 4.2 4.2 × 4 gpm* = 16.8 gpm
Laurel, DE	1) House Width: 40 ft 2) House Windspeed: 700 fpm 3) Ventilation Capacity: 280,000 cfm	(280,000 cfm) / (100,000 cfm) = 2.8 2.8 × 3.8 gpm* = 10.6 gpm
Laurel, DE	1) House Width: 50 ft 2) House Windspeed: 700 fpm 3) Ventilation Capacity: 350,000 cfm	(350,000 cfm) / (100,000 cfm) = 3.5 3.5 × 3.8 gpm* = 13.3 gpm
Laurel, DE	1) House Width: 60 ft 2) House Windspeed: 700 fpm 3) Ventilation Capacity: 420,000 cfm	(420,000 cfm) / (100,000 cfm) = 4.2 4.2 × 3.8 gpm* = 16.0 gpm
Livingston, CA	1) House Width: 40 ft 2) House Windspeed: 700 fpm 3) Ventilation Capacity: 280,000 cfm	(280,000 cfm) / (100,000 cfm) = 2.8 2.8 × 5.2 gpm* = 14.6 gpm
Livingston, CA	1) House Width: 50 ft 2) House Windspeed: 700 fpm 3) Ventilation Capacity: 350,000 cfm	(350,000 cfm) / (100,000 cfm) = 3.5 3.5 × 5.2 gpm* = 18.2 gpm
Livingston, CA	1) House Width: 60 ft 2) House Windspeed: 700 fpm 3) Ventilation Capacity: 420,000 cfm	(420,000 cfm) / (100,000 cfm) = 4.2 4.2 × 5.2 gpm* = 21.8 gpm

*These values are from Figure 3 for each geographical location.

Now, estimate your make-up water needs by filling in the information below!

Your Location _____	1) House Width: _____ ft 2) House Windspeed: _____ fpm 3) Ventilation Capacity: _____ cfm	$\frac{\text{(Ventilation Capacity (cfm))}}{\text{(100,000 cfm)}} = \underline{\hspace{2cm}}$ $\underline{\hspace{2cm}} \times \underline{\hspace{2cm}} \text{ gpm} = \underline{\hspace{2cm}} \text{ gpm}$ (Figure 2)
---------------------	---	--

Publication 3329 (POD-02-20)

By **John Linhoss**, PhD, Assistant Extension Professor, Agricultural and Biological Engineering; **Joseph Purswell**, PhD, Research Agricultural Engineer, USDA ARS Poultry Research Unit; **Jeremiah Davis**, PhD, Director and Associate Professor, National Poultry Technology Center, Auburn University; and **Jess Campbell**, PhD, Poultry Housing Specialist, National Poultry Technology Center, Auburn University.



Copyright 2020 by Mississippi State University. All rights reserved. This publication may be copied and distributed without alteration for nonprofit educational purposes provided that credit is given to the Mississippi State University Extension Service.

Produced by Agricultural Communications.

Mississippi State University is an equal opportunity institution. Discrimination in university employment, programs, or activities based on race, color, ethnicity, sex, pregnancy, religion, national origin, disability, age, sexual orientation, genetic information, status as a U.S. veteran, or any other status protected by applicable law is prohibited. Questions about equal opportunity programs or compliance should be directed to the Office of Compliance and Integrity, 56 Morgan Avenue, P.O. 6044, Mississippi State, MS 39762, (662) 325-5839.

Extension Service of Mississippi State University, cooperating with U.S. Department of Agriculture. Published in furtherance of Acts of Congress, May 8 and June 30, 1914. GARY B. JACKSON, Director